


(T/R%)

Pilkington Spectrum Program v6.12.14 R+D

Date: 31/07/06

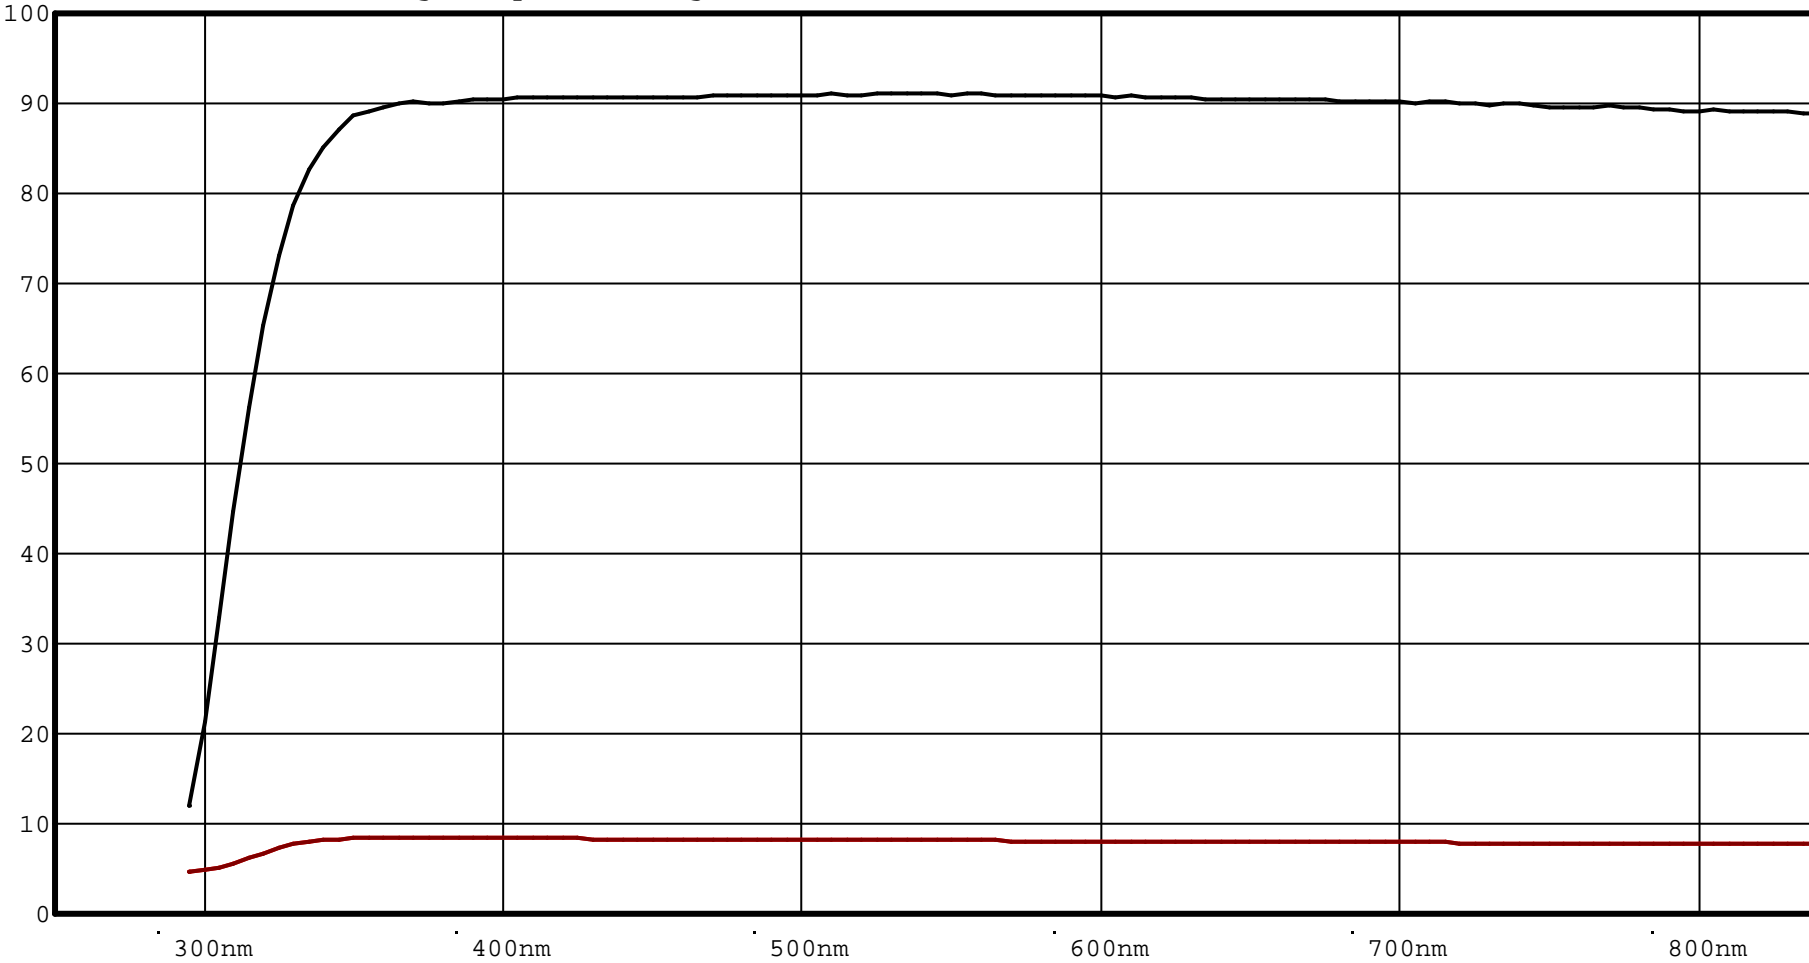

IGU Loaded from Database

Trans   Coat   Glass

{3mm Optiwhite t=2.90mm average curve from 2 files.}, {Original File Name: , Uncoated}, em2=0.837, {Thickness=2.9mm}